

VILLAGE OF WEST FARMINGTON, OHIO

ORDINANCE NO. 3-2020

AN ORDINANCE FOR THE PURPOSE OF PROVIDING AN EFFECTIVE MEANS FOR PROTECTING THE VILLAGE'S PUBLIC WATER SYSTEM FROM CONTAMINATION DUE TO BACKFLOW OF CONTAMINANTS THROUGH THE WATER SERVICE CONNECTION INTO THE VILLAGE'S PUBLIC WATER SYSTEM.

WHEREAS, Section 6109.13 of the Ohio Revised Code requires protection of the public water system from contamination through any connection whereby water from a private, auxiliary or emergency water system may enter the public water system;

WHEREAS, Section 3745-95 of the Ohio Administrative Code requires protection of the public water system from contamination due to backflow of contaminants through the water service connection;

WHEREAS, the Ohio Environmental Protection Agency requires the maintenance of a continuing program of backflow prevention and cross-connection control which will systematically and effectively prevent the contamination of all potable water systems; and

WHEREAS, to accomplish these goals it is necessary to introduce restrictions that go beyond usual plumbing code requirements.

NOW, THEREFORE, BE IT ORDAINED BY THE COUNCIL OF THE VILLAGE OF West Farmington, TRUMBULL COUNTY, STATE OF OHIO, that:

Section 1. Cross-Connection Control – General Policy

A. Purpose. The purpose of these Rules and Regulations is:

1. To protect the public potable water supply from contamination or pollution by isolating within the consumer's water system contaminants or pollutants which could backflow through the service connection into the public water system.
2. To promote the elimination or control of existing cross-connections, actual or potential, between the public or consumer's potable water system and non-potable water systems, plumbing fixtures and sources or systems containing process fluids.

3. To provide for the maintenance of a continuing program of backflow prevention and cross-connection control which will systematically and effectively prevent the contamination or pollution of the public and consumer's potable water systems.

B. Application. These Rules and Regulations shall apply to all premises served by the public water system of the Village of West Farmington, Ohio.

C. Policy. The Mayor or Mayor's designee shall be responsible for the protection of the public water system from contamination due to backflow of contaminants through the water service connection. If, in the judgment of the Mayor or Mayor's designee, an approved backflow prevention assembly is necessary at the water service connection to any consumer's premises for the safety of the water system, the Mayor or Mayor's designee or his authorized representative shall give notice to the consumer to install such approved backflow prevention assembly at each service connection to his premises. The consumer shall immediately install such approved assembly or assemblies at his own expense, and failure, refusal or inability on the part of the consumer to install such assembly or assemblies immediately shall constitute grounds for discontinuing water service to the premises until such assemblies have been installed.

Section 2. Definitions.

A. The following definitions shall apply in the interpretation and enforcement of these rules and regulations:

1. "Air gap separation" means the unobstructed vertical distance through the free atmosphere between the lowest opening from any pipe or faucet supplying water to a tank, plumbing fixture, or other device and the flood level rim of the receptacle.
2. "Approved" means that a backflow prevention device or method has been accepted by the supplier of water and the director as suitable for the proposed use.
3. "Auxiliary water system" means any water system on or available to the premises other than the public water system and includes the water supplied by the system. These auxiliary waters may include water from another supplier's public water system; or water from a source such as wells, lakes, or streams; or process fluids; or used water. They may be polluted or contaminated or objectionable or constitute a water source or system over which the supplier of water does not have control.

4. "Backflow" means the flow of water or other liquids, mixtures, or substances into the distributing pipes of a potable water supply from any other source other than the intended source of the potable water supply.
5. "Backflow preventer" means any assembly, device, method, or type of construction intended to prevent backflow into a potable water system. Where backflow prevention device is used in other rules of this chapter (OAC 3745-95), this definition applies.
6. "Consumer" means the owner or person in control of any premises supplied by or in any manner connected to a public water system.
7. "Consumer's water system" means any water system, located on the consumer's premises, supplied by or in any manner connected to a public water system. A household plumbing system is considered to be a consumer's water system.
8. "Containment principle backflow preventer" means a backflow preventer that is installed in a consumer's water system that is intended to contain the water within the premises to prevent any polluted or contaminated water from backflowing into the public water system. Typically, the containment principle backflow preventer is placed at the service connection, unless placement is otherwise specified by rule herein.
9. "Contamination" means an impairment of the quality of the water by sewage or process fluid or waste to a degree which could create an actual hazard to the public health through poisoning or through spread of disease by exposure.
10. "Cross-connection" means any arrangement whereby backflow can occur.
11. "Degree of hazard" is a term derived from an evaluation of the potential risk to health and the adverse effect upon the potable water system.
12. "Director" means the director of the Ohio Environmental Protection Agency or his duly authorized representative.
13. "Double check valve assembly" means an assembly composed of two single, independently acting, check valves including tightly closing shutoff valves located at each end of the assembly and suitable connections for testing the water-tightness of each check valve.

14. "Health hazard" means any condition, device, or practice in a water system or its operation that creates, or may create, a danger to health and well-being of users. The word "severe" as used to qualify "health hazard" means a hazard to the health of the user that could reasonably be expected to result in significant morbidity or death.
15. "Interchangeable connection" means an arrangement or device that will allow alternate but not simultaneous use of two sources of water.
16. "Non-potable water" means water not safe for drinking, personal, or culinary use.
17. "Person" means the state, any political subdivision, public or private corporation, individual, partnership, or other legal entity.
18. "Pollution" means the presence in water of any foreign substance that tends to degrade its quality so as to constitute a hazard or impair the usefulness or quality of the water to a degree which does not create an actual hazard to the public health, but which does adversely and unreasonably affect such waters for domestic use.
19. "Potable water" means water which is satisfactory for drinking, culinary, and domestic purposes and meets the requirements of the Ohio Environmental Protection Agency.
20. "Premises" means any building, structure, dwelling or area containing plumbing or piping supplied from a public water system.
21. "Process fluids" means any fluid or solution which may be chemically, biologically or otherwise contaminated or polluted in a form or concentration such as would constitute a health, pollution, or system hazard if introduced into the public or a potable consumer's water system. This includes, but is not limited to:
 - a. polluted or contaminated waters;
 - b. process waters;
 - c. used waters originated from the public water system which may have deteriorated in sanitary quality;
 - d. cooling waters;
 - e. contaminated natural waters taken from wells, lakes, streams, or irrigation systems;
 - f. chemicals in solution or suspension; and

- g. oils, gases, acids, alkalis, and other liquid and gaseous fluids used in industrial or other processes, or for firefighting purposes.
- 22. "Public water system" has the meaning ascribed to such term in Section 6109.01 and 6109.02 of the Ohio Revised Code.
- 23. "Reduced pressure principle backflow prevention assembly" means an assembly containing a minimum of two independently acting check valves together with an automatically operated pressure differential relief valve located between two check valves. During normal flow and the cessation of normal flow, the pressure between these two checks shall be less than the supply pressure. In case of leakage of either check valve, the differential relief valve, by discharging to the atmosphere, shall operate to maintain the pressure between the check valves at less than the supply pressure. The unit must include tightly closing shutoff valves located at each end of the device, and each device shall be fitted with properly located test cocks.
- 24. "Service connection" means the terminal end of a service line from the public water system. If a meter is installed at the end of the service, then the service connection means the downstream end of the meter.
- 25. "Supplier of water" means the owner or operator of a public water system.
- 26. "System hazard" means a condition posing an actual or potential threat of damage to the physical properties of the public water system or a potable consumer's water system.
- 27. "Pollutional hazard" means a condition through which an aesthetically objectionable or degrading material not dangerous to health may enter the public water system or a potable consumer's water system.
- 28. "Used water" means any water supplied by a supplier of water from a public water system to a consumer's water system after it has passed through the service connection and is no longer under the control of the supplier.

Section 3. Water System.

- A. The water system shall be considered as made up of two parts: the public water system and the consumer's water system.
- B. The public water system shall consist of the source facilities and the distribution system and shall include all those facilities of the water system under the control of

the Mayor or Mayor's designee up to the point where the consumer's water system begins.

- C. The source shall include all components of the facilities utilized in the production, treatment, storage and delivery of water to the public distribution system.
- D. The public distribution system shall include the network of conduits used for delivery of water from the source to the consumer's water system.
- E. The consumer's water system shall include those parts of the facilities beyond the service connection which are utilized in conveying water from the public distribution system to points of use.

Section 4. Cross-Connections Prohibited.

- A. No water service connection shall be installed or maintained to any premises where actual or potential cross-connections to the public potable or consumer's water system may exist unless such actual or potential cross-connections are abated or controlled to the satisfaction of the Mayor or Mayor's designee.
- B. No connection shall be installed or maintained whereby water from an auxiliary water system may enter a public water system and the method of connection and use of such system shall have been approved by the Mayor or Mayor's designee and by the Director of the Ohio Environmental Protection Agency as required by Section 6109.13 of the Ohio Revised Code.

Section 5. Survey and Investigations.

- A. The consumer's premises shall be open at all reasonable times to the Mayor or Mayor's designee or his authorized representative for the conduction of surveys and investigations of water use practices within the consumer's premises to determine whether there are actual or potential cross-connections to the consumer's water system through which contaminants or pollutants could backflow into the public potable water system.
- B. On request by the Mayor or Mayor's designee or his authorized representative the consumer shall furnish information on water use practices within his premises.
- C. It shall be the responsibility of the water consumer to conduct periodic surveys of water use practices on his premises to determine whether there are actual or potential cross-connections in his water system through which contaminants or pollutants could backflow into his or the public potable water system.

Section 6. Where Protection Is Required.

- A. An approved backflow prevention assembly shall be installed on each service line to a consumer's water system serving premises, where in judgment of the Mayor or Mayor's designee or the Director, actual or potential hazards to the public potable water system exist.

- B. An approved backflow prevention assembly shall be installed on each service line to a consumer's water system serving premises where the following conditions exist:
 - 1. Premises having an auxiliary water system, unless such auxiliary system is accepted as an additional source by the Mayor or Mayor's designee and the source is approved by the Director of the Ohio Environmental Protection Agency;
 - 2. Premises on which any substance is handled in such a fashion as to create an actual or potential hazard to the public potable water system. This shall include premises having sources or systems containing process fluids or waters originating from the public potable water system which are no longer under the sanitary control of the Mayor or Mayor's designee;
 - 3. Premises having internal cross-connections that, in the judgment of the Mayor or Mayor's designee, are not correctable, or intricate plumbing arrangements which make it impractical to determine whether or cross-connections exist;
 - 4. Premises, where, because of security requirements or other prohibitions or restrictions, it is impossible or impractical to make a complete cross-connection survey;
 - 5. Premises having a repeated history of cross-connections being established or re-established;
 - 6. Others specified by the Mayor or Mayor's designee or the Director.

- C. An approved backflow prevention assembly shall be installed on each service line to a consumer's water system serving, but not necessarily limited to, the following types of facilities unless the Mayor or Mayor's designee or the Director determines that no actual or potential hazard to the public water system exists:
 - 1. Hospitals, mortuaries, clinics, nursing homes;
 - 2. Laboratories;

3. Piers, docks, waterfront facilities;
 4. Sewage treatment plants, sewage pumping stations or storm water pumping stations;
 5. Food or beverage processing plants;
 6. Chemical plants;
 7. Metal plating industries;
 8. Petroleum processing or storage plants;
 9. Radioactive material processing plants or nuclear reactors; 10. Car washes;
 11. Others specified by the Mayor or Mayor's designee or the Director.
- D. An approved backflow prevention assembly shall be installed at any point of connection between the public or consumer's water system and an auxiliary water system, unless such auxiliary system is accepted as an additional source by the Mayor or Mayor's designee and the source is approved by the Director of the Ohio Environmental Protection Agency.

Section 7. Type of Protection Required.

- A. The type of protection required under Sections 6.A, 6.B and 6.C of these regulations shall depend on the degree of hazard which exists as follows:
1. An approved air gap separation shall be installed where the public water system may be contaminated with substances that could cause severe health hazard;
 2. An approved air gap separation or an approved reduced pressure principle backflow prevention assembly shall be installed where the public water system may be contaminated with any substance that could cause a system or health hazard;
 3. An approved air gap separation or an approved reduced pressure principle backflow prevention assembly or an approved double check valve assembly shall be installed where the public water system may be polluted with substances that could cause a pollutional hazard not dangerous to health.
- B. The type of protection required under Section 6.D of these regulations shall be an approved air gap separation or any approved interchangeable connection.
- C. Where an auxiliary water system is used as a secondary source of water for a fire protection system, the provisions of Section 7.B for an approved air gap separation or an approved interchangeable connection may not be required, provided:

1. At premises where the auxiliary water system may be contaminated with substances that could cause a system or health hazard, the public consumer's potable water system shall be protected against backflow by installation of an approved reduced pressure principle backflow prevention assembly;
2. At all other premises, the public or consumer's potable water system shall be protected against backflow by installation of either an approved reduced pressure principle backflow prevention assembly or an approved double check valve assembly;
3. The public or consumer's potable water system shall be the primary source of water for the fire protection system;
4. The fire protection system shall be normally filled with water from the public or consumer's potable water system;
5. The water in the fire protection system shall be used for fire protection only, with no regular use of water from the fire protection system downstream from the approved backflow prevention assembly;
6. The water in the fire protection system shall contain no additives.

Section 8. Backflow Preventers.

- A. Any backflow preventer required by these rules and regulations shall be of a model or construction approved by the Mayor or Mayor's designee and the Director and shall comply with the following:
 1. An air gap separation, to be approved, shall be at least twice the diameter of the supply pipe, measured vertically above the top rim of the vessel, but in no case less than one inch. It shall meet the requirements of OAC Rule 3745-95-04 of the Ohio Environmental Protection Agency
 2. A double check valve assembly or a reduce pressure principle backflow prevention assembly shall be approved by the Mayor or Mayor's designee and shall meet the requirements of OAC Rule 3745-95-04 of the Ohio Environmental Protection Agency.
 3. An interchangeable connection, to be approved, shall be either a swing type connector or a four-way valve mechanism which unseats the plug, turns it ninety degrees and reseats the plug. Four-way valves shall stop valves on

each pipe connected to the valve. The telltale port on the four-way valve shall have no piping connected and the threads or flange on this port shall be destroyed so that a connection cannot be made.

- B. Existing backflow preventers approved by the Mayor or Mayor's designee or the Director of the Ohio Environmental Protection Agency at the time of the installation and properly maintained shall, except for inspection, testing and maintenance requirements, be excluded from the requirement of Section 8.A of this regulation providing the Mayor or Mayor's designee is assured that they will satisfactorily protect the public potable water system. Whenever the existing backflow preventer is moved from the present location or requires more than minimum maintenance or when the Mayor or Mayor's designee finds that the maintenance of the backflow preventer constitutes a hazard to health, the backflow preventer shall be replaced by a backflow prevention assembly meeting the requirements of these regulations.

Section 9. Installation.

- A. Backflow prevention assemblies required by these rules and regulations shall be installed at a location and in a manner approved by the Mayor or Mayor's designee and at the expense of the water consumer. In addition, any backflow prevention assembly required by Section 7.B and 7.C of these regulations shall be installed at a location and in a manner approved by the Director of the Ohio Environmental Protection Agency as required by Section 6109.13 of the Ohio Revised Code.
- B. Backflow prevention assemblies installed on the service line to a consumer's water system shall be located on the consumer's side of the water meter, as close to the meter as is reasonably practical, and prior to any other connection.
- C. Pits or vaults shall be of water-tight construction, be so located and constructed as to prevent flooding and shall be maintained free from standing water by means of either a sump and pump or a suitable drain. Such sump pump or drain shall not connect to a sanitary sewer nor permit flooding of the pit or vault by reverse flow from its point of discharge. An access ladder and adequate natural or artificial lighting shall be provided to permit maintenance, inspection and testing of the backflow prevention device.
- D. Reduced pressure principle backflow prevention assembly must be installed above ground level or floor level, whichever is higher.

Section 10. Inspection and Maintenance.

- A. It shall be the duty of the consumer at any premises on which backflow preventers required by these regulations are installed to have inspections, tests,

and overhauls made in accordance with the following schedule, or more often where inspections indicate a need:

1. Air gap separations shall be inspected at the time of installation and at least every twelve months thereafter;
2. Double check valve assemblies shall be inspected and tested for tightness at the time of installation and at least every twelve months thereafter.

They shall be dismantled, inspected internally, cleaned and repaired whenever needed.

3. Reduced pressure principle backflow prevention assemblies shall be inspected and tested for tightness at the time of installation and at least every twelve months thereafter.
4. Interchangeable connections shall be inspected at the time of installation and at least every twelve months thereafter.

- B. Inspections, tests, and overhauls of backflow prevention assemblies shall be made at the expense of the water consumer and shall be performed by the Mayor or Mayor's designee or a person approved by the Mayor or Mayor's designee as qualified to inspect, test and overhaul backflow prevention assemblies.
- C. Whenever backflow prevention assemblies required by these regulations are found to be defective, they shall be repaired, overhauled or replaced at the expense of the consumer without delay.
- D. The water consumer must maintain a complete record of each backflow preventer from purchase to retirement. This shall include a comprehensive listing that includes a record of all tests, inspections, repairs and overhauls. Records of inspections, tests, repairs and overhaul shall be submitted to the Mayor or Mayor's designee.
- E. Backflow preventers shall not be bypassed, made inoperative, removed or otherwise made ineffective without specific authorization by the Mayor or Mayor's designee.

Section 11. Booster Pumps.

- A. For booster pumps not intended to be used for fire suppression, such booster pump shall be equipped with a low-pressure cut-off designed to shut-off the booster pump

when the pressure in the service line on the suction side of the pump drops to ten pounds per square inch gauge or less.

- B. For booster pumps, or fire pumps, used for fire suppression installed after August 8, 2008, such booster pump, or fire pump, shall be equipped with one of the following:
1. A low suction throttling valve on the booster pump discharge, which throttles the discharge of the pump when necessary so that suction pressure will not be reduced below ten pounds per square inch gauge while the pump is operating; or,
 2. The fire pump is equipped with a variable speed suction limiting control on the booster, or fire, pump. The speed control system must be used to maintain a minimum suction pressure of ten pounds per square inch gauge at the pump inlet by reducing the pump driver speed while monitoring pressure in the suction piping through a sensing line.
- C. It shall be the duty of the water consumer to maintain the low-pressure cut-off device, low suction throttling valve, or variable speed suction limiting control, in proper working order and to certify to the Mayor or Mayor's designee, at least once every twelve months that the minimum pressure sustaining method in place is operating properly.

Section 12. Violations.


- A. The Mayor or Mayor's designee shall deny or discontinue, after reasonable notice to the occupants thereof, the water service to any premises wherein any backflow prevention device required by these regulations is not installed, tested and maintained in a manner acceptable to the Mayor or Mayor's designee, or if it is found that the backflow preventer has been removed or by-passed, or if an unprotected cross-connection exists on the premises, or if the minimum pressure sustaining method required by these regulations is not installed and maintained in working order.
- B. Water service to such premises shall not be restored until the consumer has corrected or eliminated such conditions or defects in conformance with these regulations and to the satisfaction of the Mayor or Mayor's designee.

Section 13. Any and all other Ordinances, Resolutions, sections, or parts thereof inconsistent or in conflict with the terms of this Ordinance are hereby repealed.

Section 14. The passage of this Ordinance and all deliberations relating to the passage of this Ordinance were held in open meetings in accordance with the provisions of Ohio Revised Code Section 121.22.


Section 15. This Ordinance shall be in full force and effect from the earliest period allowed by law.

Passed in Council this 18th day of May 2020.

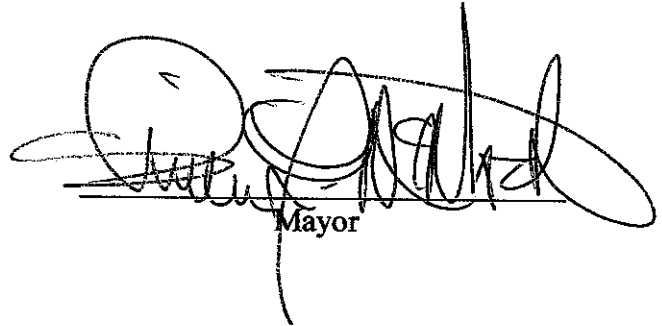

Handwritten signature of the Mayor, with the word "Mayor" printed below the signature line.

Attest To:

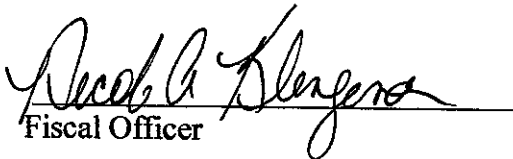

Handwritten signature of the Fiscal Officer, with the text "Fiscal Officer" printed below the signature line.